

- GENERAL NOTES:**
- DO NOT SCALE. ALL DIMENSIONS ON DRAWINGS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE. USE FIGURED DIMENSIONS ONLY.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER WORKS REQUIREMENTS.
 - ANY QUERIES OR DISCREPANCIES ARE TO BE REFERRED TO THE EMPLOYER'S REPRESENTATIVE IMMEDIATELY.


MATERIALS IN CONTACT WITH POTABLE WATER

ALL MATERIALS, SUBSTANCES AND PRODUCTS IN CONTACT WITH POTABLE WATER SHALL COMPLY IN ALL RESPECTS WITH THE EUROPEAN COMUNITIES DRINKING WATER REGULATION, 2007 (L.N. NO. 278 OF 2007) AND SHALL BE INCLUDED IN THE LATEST LIST OF APPROVED PRODUCTS AND PROCESSES PUBLISHED BY THE DRINKING WATER REGULATORY AUTHORITY. THE CONTRACTOR SHALL PROVIDE DOCUMENTARY EVIDENCE THAT THE SUBSTANCE OR PRODUCT HAS BEEN SPECIFICALLY APPROVED UNDER THE DWS SYSTEM, OR EQUIVALENT APPROVAL SYSTEM.

PROPRIETARY PRODUCT NAMES, MANUFACTURER'S NAMES, SUPPLIER'S NAMES, NATIONAL STANDARDS

WHERE A SPECIFICATION OR A DESCRIPTION OF A PRODUCT OR ELEMENT OF WORK INCLUDES A SPECIFIC NAME OR SOURCE SUCH AS A PRODUCT NAME OR MANUFACTURER'S NAME OR A SUPPLIER'S NAME OR A NATIONAL STANDARD, THE SPECIFICATION OR DESCRIPTION SHALL BE DEEMED TO BE ACCOMPANIED BY THE WORDS "OR EQUIVALENT" NOTWITHSTANDING THAT THESE EXACT WORDS MAY NOT IN FACT ACCOMPANY THE NAME OR STANDARD. THIS ALSO APPLIES WHERE THE NAME OR STANDARD IS ACCOMPANIED BY OTHER WORDS SUCH AS "OR EQUAL APPROVED" OR SIMILAR PHRASES.

- LEGEND**
- SITE BOUNDARY: Solid red line
 - EXISTING WATERMAIN (150mm FROM RECORD DRAWINGS): Dashed green line
 - PROPOSED WATERMAIN (125mm OD PERD SDR17 PIPE): Dashed blue line
 - IRISH WATER APPROVED BOUNDARY BOX & METER WITH 25mm OD PERD SDR17 PIPE: BB symbol
 - PROPOSED FIRE HYDRANT: H symbol
 - PROPOSED SLUICE VALVE: SV symbol
 - PROPOSED UTILITY DUCTS: Solid yellow line
 - WAYLEAVE: Yellow shaded area
 - OVERHEAD LINES (DESIGNED BY OTHERS): Dashed grey line
 - ELECTRICITY POLE (DESIGN BY OTHERS): EP symbol

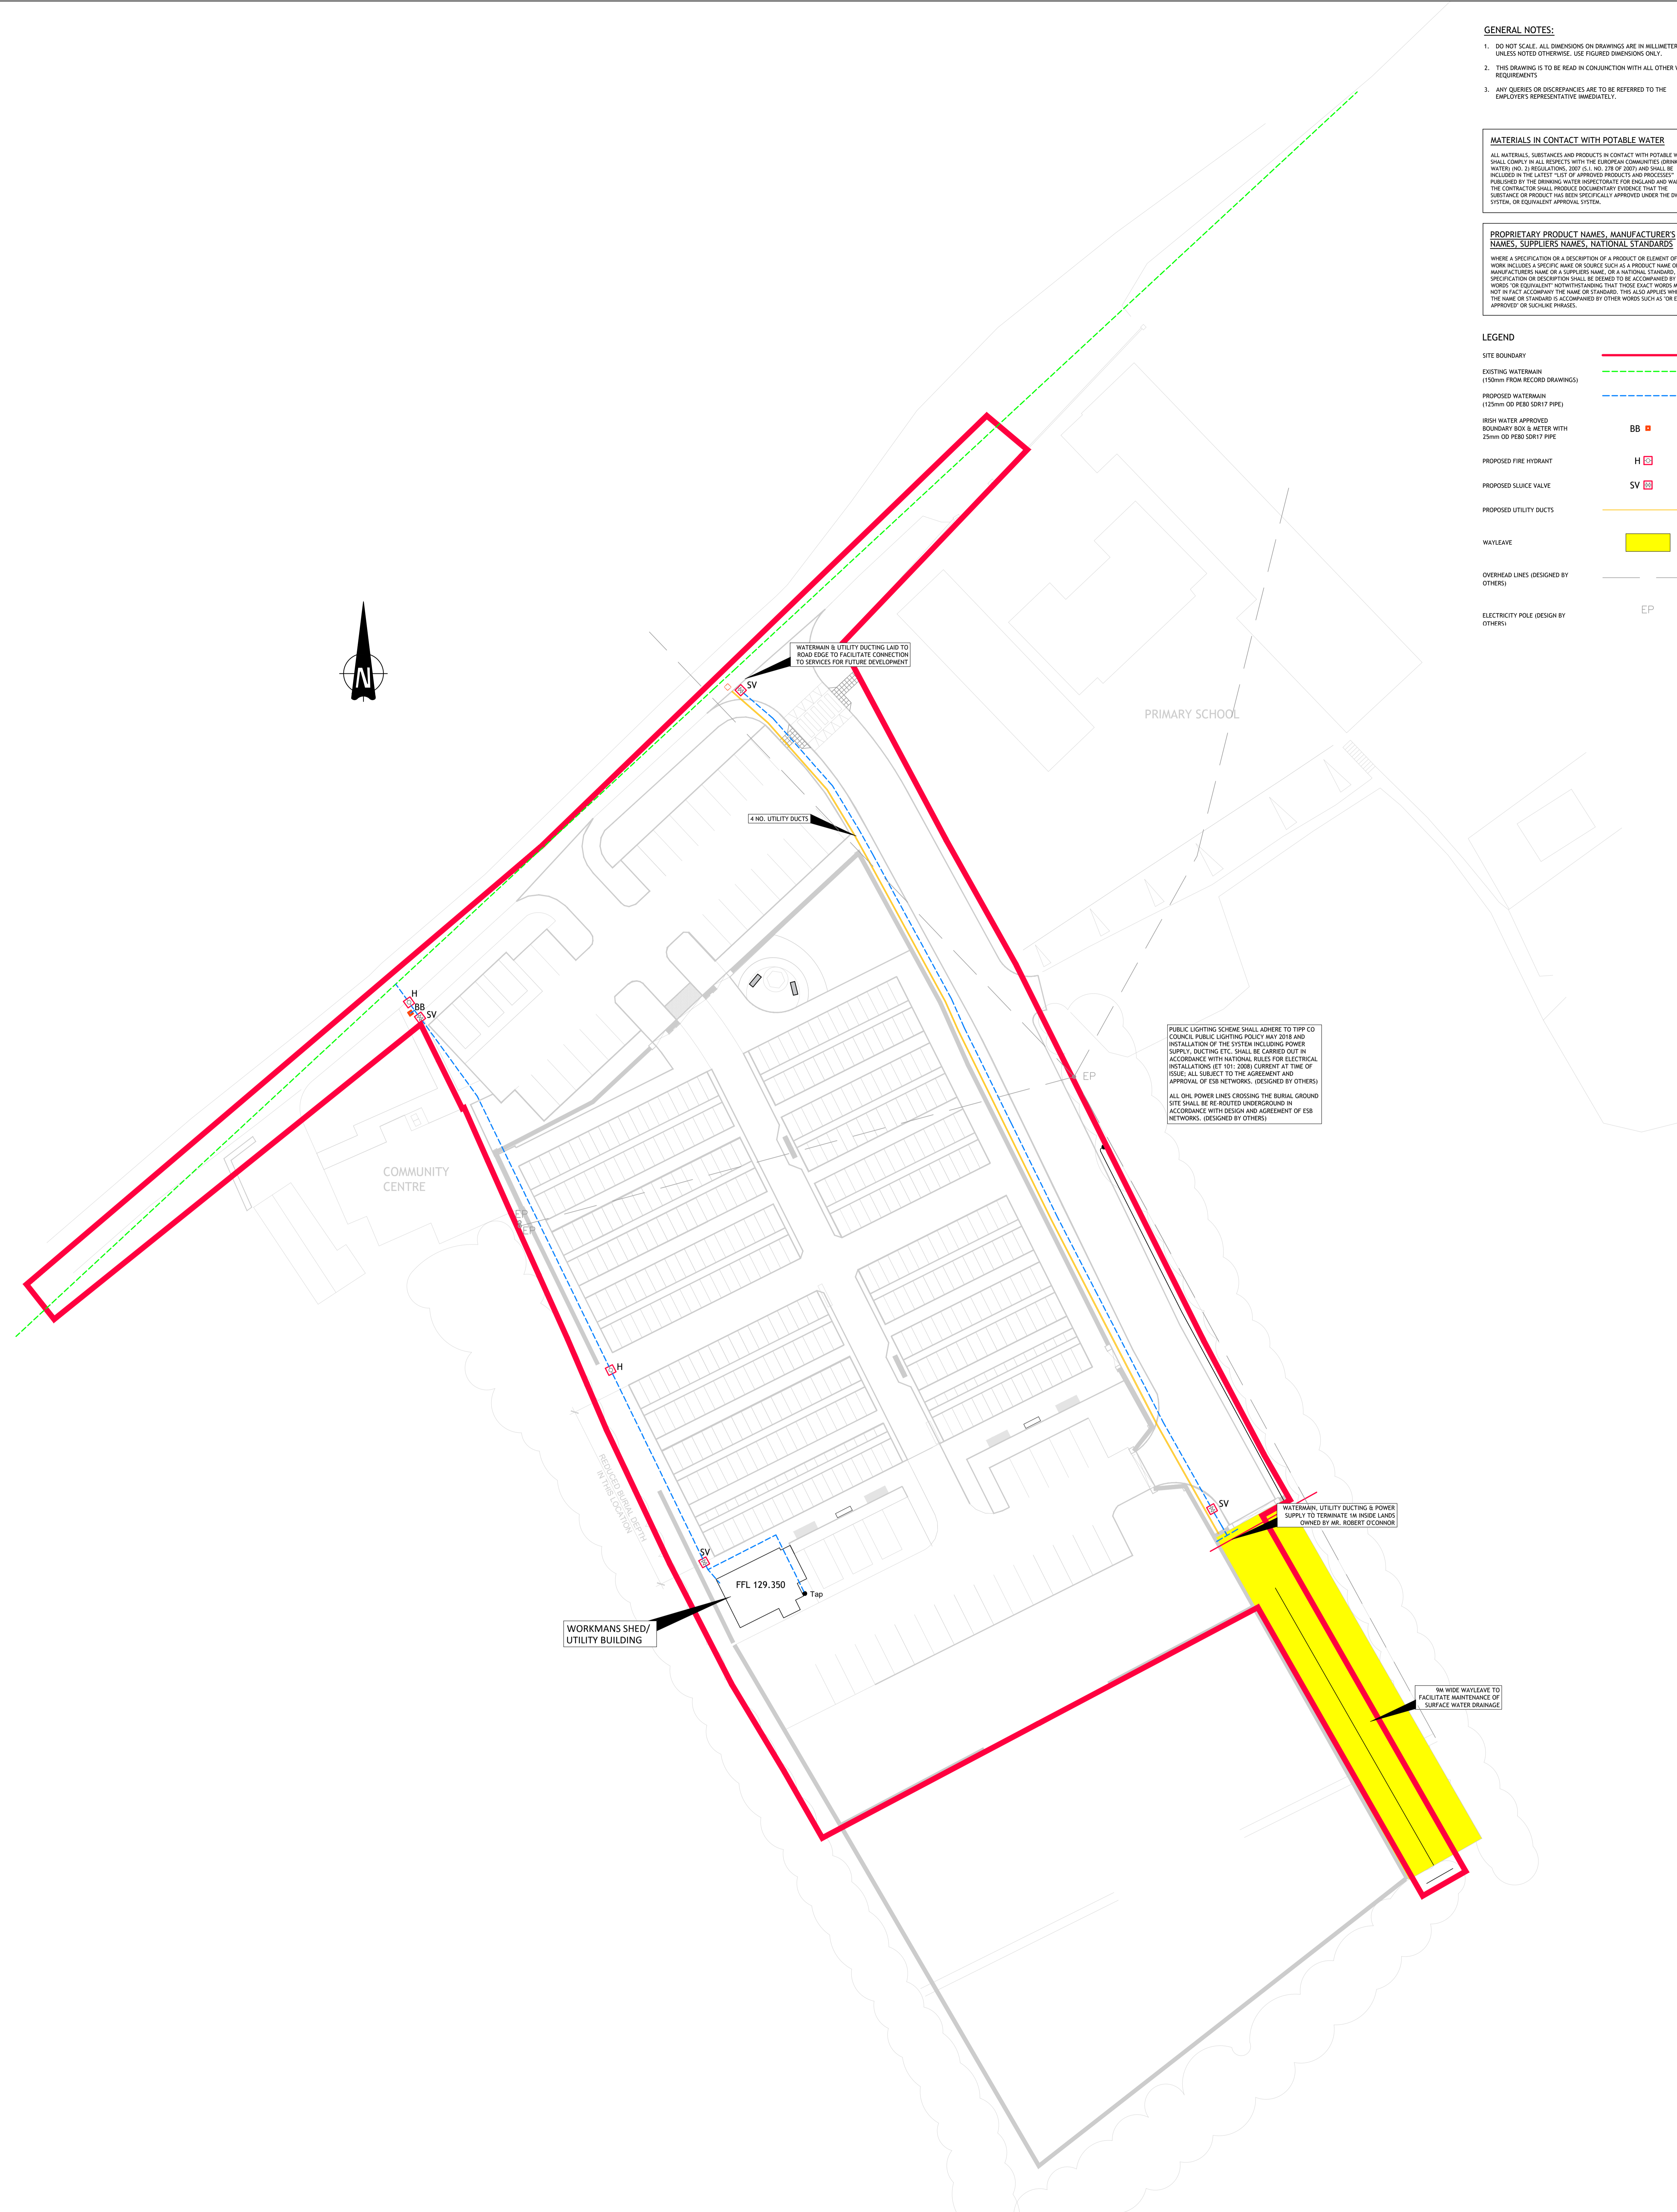

WATERMAIN & UTILITY DUCTING LAD TO ROAD EDGE TO FACILITATE CONNECTION TO SERVICES FOR FUTURE DEVELOPMENT

4 NO. UTILITY DUCTS

PUBLIC LIGHTING SCHEME SHALL ADHERE TO TIPP CO COUNCIL PUBLIC LIGHTING POLICY (MAY 2018) AND INSTALLATION OF THE SYSTEM INCLUDING POWER SUPPLY, DUCTING ETC. SHALL BE CARRIED OUT IN ACCORDANCE WITH NATIONAL RULES FOR ELECTRICAL INSTALLATIONS (ET 181:2008) CURRENT AT TIME OF ISSUE, AS SUBJECT TO THE AGREEMENT AND APPROVAL OF ESB NETWORKS, (DESIGNED BY OTHERS). ALL OHL POWER LINES CROSSING THE BURIAL GROUND SITE SHALL BE ROUTED UNDERGROUND IN ACCORDANCE WITH DESIGN AND AGREEMENT OF ESB NETWORKS, (DESIGNED BY OTHERS).

WATERMAIN, UTILITY DUCTING & POWER SUPPLY TO TERMINATE IN HOUSE LANDS OWNED BY MR. ROBERT O'CONNOR

8M WIDE WAYLEAVE TO FACILITATE MAINTENANCE OF SURFACE WATER DRAINAGE

WORKMANS SHED/ UTILITY BUILDING

FFL 129.350 Tap

Rev	Amendment	By	Date
PL0	ISSUED FOR CLIENT COMMENTS	SK	2019-02-20
PL1	UTILITY DUCTS ADDED	TH	2019-05-01
PL2	REVISED AS PER CLIENTS COMMENTS & ISSUED FOR PART B PLANNING	TH	2019-10-21
PL3	REVISED AS PER CLIENTS COMMENTS & ISSUED FOR PART B PLANNING	CM	2020-03-10
PL4	REVISED AS PER CLIENTS COMMENTS & ISSUED FOR PART B PLANNING	CM	2020-03-30
PL5	REVISED AS PER CLIENTS COMMENTS & ISSUED FOR PART B PLANNING	JKM	2020-05-27